


10-52 A steam power plant operates on an ideal regenerative Rankine cycle with two open feedwater heaters. The net power output of the power plant and the thermal efficiency of the cycle are to be determined.

Assumptions 1 Steady operating conditions exist. 2 Kinetic and potential energy changes are negligible.

Analysis

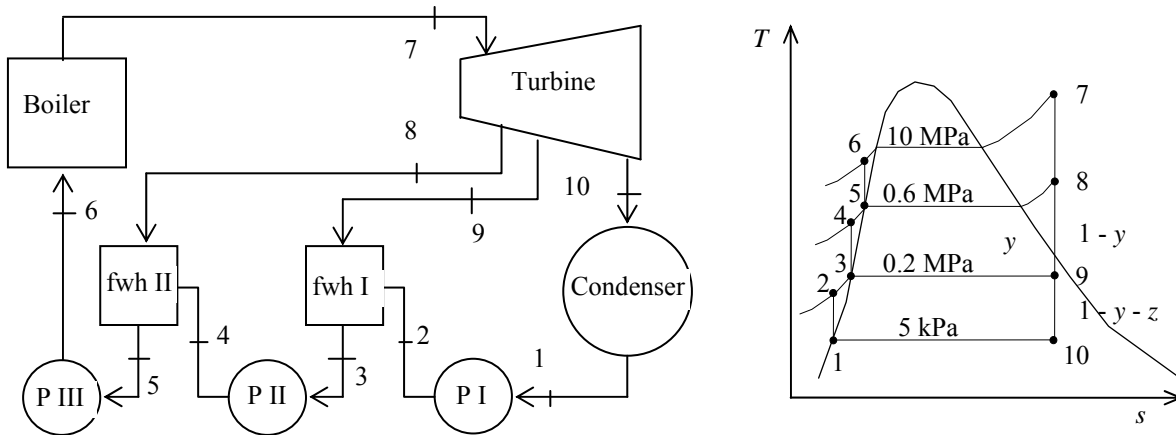

(a) From the steam tables (Tables A-4, A-5, and A-6),

$$h_1 = h_{f@5 \text{ kPa}} = 137.75 \text{ kJ/kg}$$

$$v_1 = v_{f@5 \text{ kPa}} = 0.001005 \text{ m}^3/\text{kg}$$

$$w_{pI,in} = v_1(P_2 - P_1) = (0.001005 \text{ m}^3/\text{kg})(200 - 5 \text{ kPa}) \left(\frac{1 \text{ kJ}}{1 \text{ kPa} \cdot \text{m}^3} \right) = 0.20 \text{ kJ/kg}$$

$$h_2 = h_1 + w_{pI,in} = 137.75 + 0.20 = 137.95 \text{ kJ/kg}$$

$$\left. \begin{array}{l} P_3 = 0.2 \text{ MPa} \\ \text{sat.liquid} \end{array} \right\} \begin{array}{l} h_3 = h_{f@0.2 \text{ MPa}} = 504.71 \text{ kJ/kg} \\ v_3 = v_{f@0.2 \text{ MPa}} = 0.001061 \text{ m}^3/\text{kg} \end{array}$$

$$w_{pII,in} = v_3(P_4 - P_3) = (0.001061 \text{ m}^3/\text{kg})(600 - 200 \text{ kPa}) \left(\frac{1 \text{ kJ}}{1 \text{ kPa} \cdot \text{m}^3} \right) = 0.42 \text{ kJ/kg}$$

$$h_4 = h_3 + w_{pII,in} = 504.71 + 0.42 = 505.13 \text{ kJ/kg}$$

$$\left. \begin{array}{l} P_5 = 0.6 \text{ MPa} \\ \text{sat.liquid} \end{array} \right\} \begin{array}{l} h_5 = h_{f@0.6 \text{ MPa}} = 670.38 \text{ kJ/kg} \\ v_5 = v_{f@0.6 \text{ MPa}} = 0.001101 \text{ m}^3/\text{kg} \end{array}$$

$$w_{pIII,in} = v_5(P_6 - P_5) = (0.001101 \text{ m}^3/\text{kg})(10,000 - 600 \text{ kPa}) \left(\frac{1 \text{ kJ}}{1 \text{ kPa} \cdot \text{m}^3} \right) = 10.35 \text{ kJ/kg}$$

$$h_6 = h_5 + w_{pIII,in} = 670.38 + 10.35 = 680.73 \text{ kJ/kg}$$

$$\left. \begin{array}{l} P_7 = 10 \text{ MPa} \\ T_7 = 600^\circ\text{C} \end{array} \right\} \begin{array}{l} h_7 = 3625.8 \text{ kJ/kg} \\ s_7 = 6.9045 \text{ kJ/kg} \cdot \text{K} \end{array}$$

$$\left. \begin{array}{l} P_8 = 0.6 \text{ MPa} \\ s_8 = s_7 \end{array} \right\} h_8 = 2821.8 \text{ kJ/kg}$$

$$\left. \begin{array}{l} P_9 = 0.2 \text{ MPa} \\ s_9 = s_7 \end{array} \right\} \begin{array}{l} x_9 = \frac{s_9 - s_f}{s_{fg}} = \frac{6.9045 - 1.5302}{5.5968} = 0.9602 \\ h_9 = h_f + x_9 h_{fg} = 504.71 + (0.9602)(2201.6) = 2618.7 \text{ kJ/kg} \end{array}$$

$$P_{10} = 5 \text{ kPa} \left\{ \begin{array}{l} x_{10} = \frac{s_{10} - s_f}{s_{fg}} = \frac{6.9045 - 0.4762}{7.9176} = 0.8119 \\ h_{10} = h_f + x_{10}h_{fg} = 137.75 + (0.8119)(2423.0) = 2105.0 \text{ kJ/kg} \end{array} \right.$$

The fraction of steam extracted is determined from the steady-flow energy balance equation applied to the feedwater heaters. Noting that $\dot{Q} \cong \dot{W} \cong \Delta ke \cong \Delta pe \cong 0$,

FWH-2:

$$\begin{aligned} \dot{E}_{\text{in}} - \dot{E}_{\text{out}} &= \Delta \dot{E}_{\text{system}} \stackrel{\phi^0(\text{steady})}{=} 0 \\ \dot{E}_{\text{in}} &= \dot{E}_{\text{out}} \\ \sum \dot{m}_i h_i &= \sum \dot{m}_e h_e \longrightarrow \dot{m}_8 h_8 + \dot{m}_4 h_4 = \dot{m}_5 h_5 \longrightarrow y h_8 + (1-y) h_4 = 1(h_5) \end{aligned}$$

where y is the fraction of steam extracted from the turbine ($= \dot{m}_8 / \dot{m}_5$). Solving for y ,

$$y = \frac{h_5 - h_4}{h_8 - h_4} = \frac{670.38 - 505.13}{2821.8 - 505.13} = 0.07133$$

FWH-1:

$$\sum \dot{m}_i h_i = \sum \dot{m}_e h_e \longrightarrow \dot{m}_9 h_9 + \dot{m}_2 h_2 = \dot{m}_3 h_3 \longrightarrow z h_9 + (1-y-z) h_2 = (1-y) h_3$$

where z is the fraction of steam extracted from the turbine ($= \dot{m}_9 / \dot{m}_5$) at the second stage. Solving for z ,

$$z = \frac{h_3 - h_2}{h_9 - h_2} (1-y) = \frac{504.71 - 137.95}{2618.7 - 137.95} (1 - 0.07136) = 0.1373$$

Then,

$$\begin{aligned} q_{\text{in}} &= h_7 - h_6 = 3625.8 - 680.73 = 2945.0 \text{ kJ/kg} \\ q_{\text{out}} &= (1-y-z)(h_{10} - h_1) = (1 - 0.07133 - 0.1373)(2105.0 - 137.75) = 1556.8 \text{ kJ/kg} \\ w_{\text{net}} &= q_{\text{in}} - q_{\text{out}} = 2945.0 - 1556.8 = 1388.2 \text{ kJ/kg} \end{aligned}$$

and

$$\dot{W}_{\text{net}} = \dot{m} w_{\text{net}} = (22 \text{ kg/s})(1388.2 \text{ kJ/kg}) = 30,540 \text{ kW} \cong \mathbf{30.5 \text{ MW}}$$

(b) The thermal efficiency is

$$\eta_{\text{th}} = 1 - \frac{q_{\text{out}}}{q_{\text{in}}} = 1 - \frac{1556.8 \text{ kJ/kg}}{2945.0 \text{ kJ/kg}} = \mathbf{47.1\%}$$